
Connections Topvex SX 04 HW

1	Fresh/exhaust air damper 24V	8	Signal cooling 0-10V AO
2	Fresh/exhaust air damper 24V	9	Ref DO
3	Extended running DI	10	Alarm output DO
4	Ref. DI	11	Ref AI
5	Fire alarm DI	12	Sensor supply air AI
6	Sup.voltage 24V G	13	Sup.voltage 24V G0
7	Sup.voltage 24V G0	14	Sup.voltage 24V G
		15	Signal heater 0-10V AO

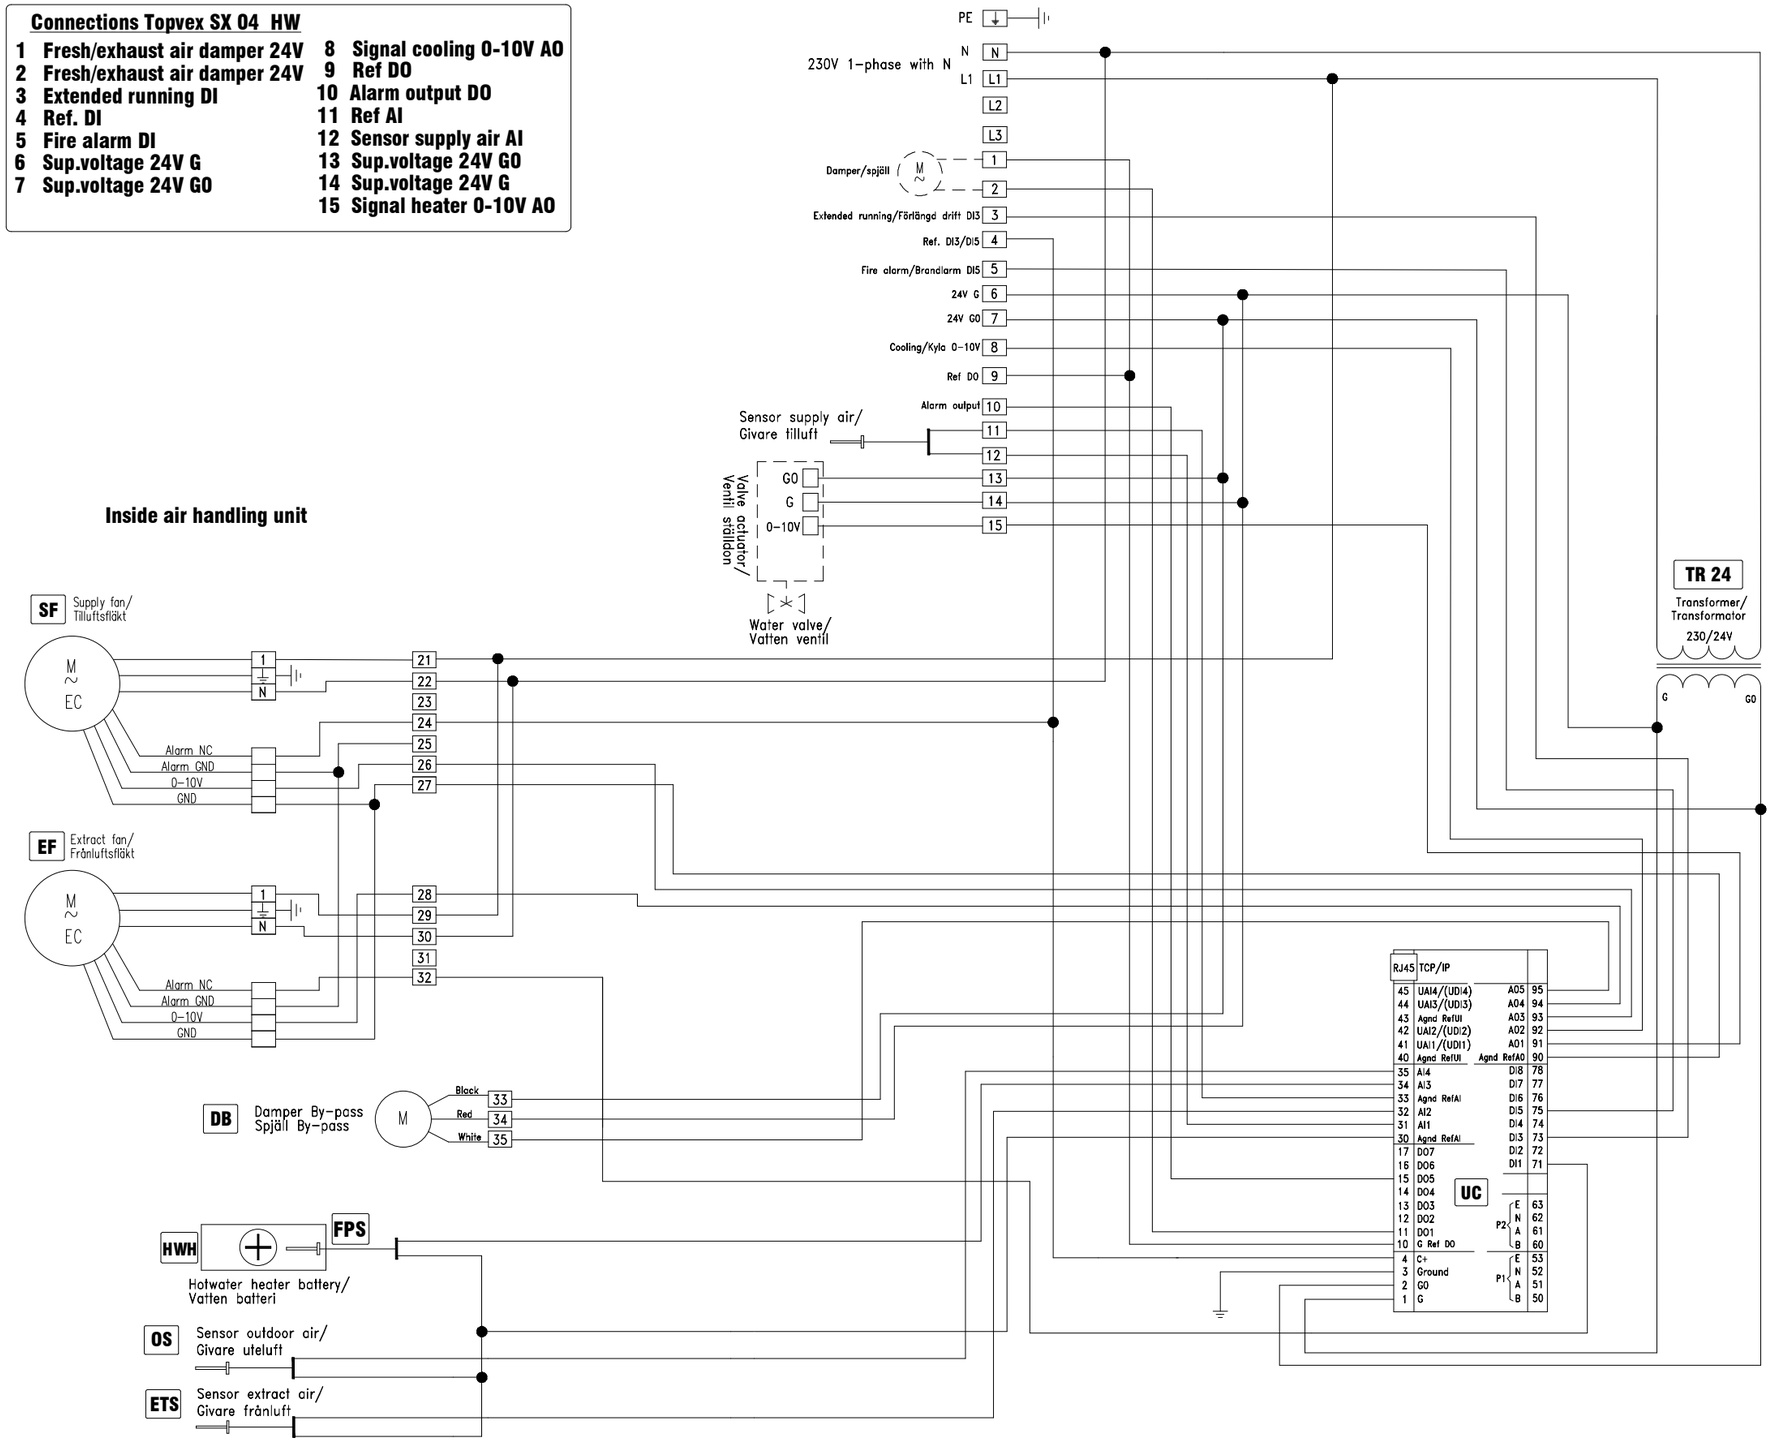

This document must not be copied without our written permission, and the contents thereof must not be imparted to a third party nor be used for any unauthorized purpose. Contravention will be prosecuted. SYSTEMAIR AB

Denna handling får ej utan vårt skriftliga medgivande kopieras. Den får ej heller delges annan eller eljest obehörigen användas. Överträdelse härav beivras med stöd av gällande lag. SYSTEMAIR AB

Det.-nr. Part.No.	Ant. Pc.	Benämning Name	Material	Mod.-nr Ämne Dimension	Anm. Note
Konstr. / Design: MO	Ritad / Drawn: DaWi	Kontr. / Checked	Standard: ISO	Godk. / App.	Skala / Scale: 1:1
					Ersätter / Replaces: 15204-51 A
					Ersatt av / Replaced by
					Art.-nr. / Art.no.
					Dat. / Date: 140526

systemair

Wiring diagram
Topvex SX 04 HW
230V 1N~

Ritn.nr. / Drawing No.: WD000023

Rev.

Nr. No.	Ant. Pc.	Ändring Amendment	Dat. Date	Sign.	Godk. App.	Nr. No.	Ant. Pc.	Ändring Amendment	Dat. Date	Sign.	Godk. App.